

WINGERTER LABORATORIES, INC.

1820 NE 144th Street, North Miami, FL 33181
TELEPHONE: 305-944-3401 FACSIMILE: 305-949-8698
Engineering Testing Inspection Services

COMPRESSIVE STRENGTH OF CONCRETE CYLINDERS

CLIENT: Blue World Crete, Inc.
CONTRACTOR:
PROJECT: Quality Control 2011
LOCATION: WLI Testing Facility, North Miami, FL

REPORT NO.: 1
W.O.#: 11-1230
PERMIT NO.:
P.O. NO.:

TRUCK TICKET INFORMATION	FIELD TEST DATA		POUR LOCATION:
Conc. Supplier: Blue World Crete, Inc Ticket No.: NR Mix Code: NR Plant: NR Time Batched: NR Code Strength: 0 in 28 days Truck No: NR Batch Size: NR	Technician: Client Field Mark: AUG58 Time Sampled: NR Batch Time: Slump: NR Conc. Temp.: NR Air Temp.: NR Weather: NR	Air (%): NR Unit Wgt.: NR Yield: NR Cu. Yd. Sampled: NR No. Cyls Made: 6 Water Added: NR Admixture: NR	Geo-Blue Crete II - Sample Batch 1

LABORATORY TEST DATA

Lab No.	Sample No.	Dia. (In)	Area (Sq. In.)	Date Made	Date Tested	Age (Days)	Break Type	Total Load (P)	Compressive Strength(PSI)
5650	1	3.00	7.07	08-Aug-11	11-Aug-11	3	4	22,520	3,190
5651	2	3.00	7.07	08-Aug-11	11-Aug-11	3	4	23,330	3,300
5652	3	3.00	7.07	08-Aug-11	15-Aug-11	7	4	36,550	5,170
5653	4	3.00	7.07	08-Aug-11	22-Aug-11	14	4	38,160	5,400
5654	5	3.00	7.07	08-Aug-11	06-Sep-11	29	4	43,680	6,180
5655	6	3.00	7.07	08-Aug-11	06-Sep-11	29	4	42,930	6,070

COPIES ISSUED TO:


Blue World Crete, Inc.
Check Status

- 1: WELL FORMED CONES
- 2: CONE & V. SPLIT
- 3: COLUMNAR W/ NO CONES
- 4: DIAGONAL
- 5: SIDE FRACTURES @ TOP OR BOTTOM
- 6: POINTED

Weight of 1st Cylinder

Remarks: Cylinders cast and information provided by client.

All field and laboratory tests and sample curing performed in accordance with applicable ASTM Test Methods. Cylinders are 6" X 12", unless otherwise indicated. Batch time denotes the time from batching to sampling.

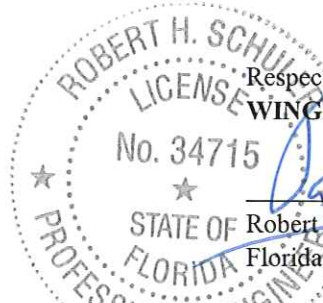

Respectfully submitted,
WINGERTER LABORATORIES, INC.

[Signature]
Robert H. Schuler, P.E., P.G.
Florida License No. 34715

9-6-11

The original of this report was signed and sealed by the herein referenced registered engineer in accordance with Rule 61G15-18.011 of the Florida Administration Code. As a mutual protection to clients, the public and ourselves, all reports are submitted as the confidential property of clients, and authorization for publication of statements, conclusions or extracts from or regarding our reports is reserved pending our written approval.